



Imported Water Committee

Water Resource Management Manager's Report


Item 7c

September 12, 2022



State Water Project Update



Low Initial Allocation Anticipated

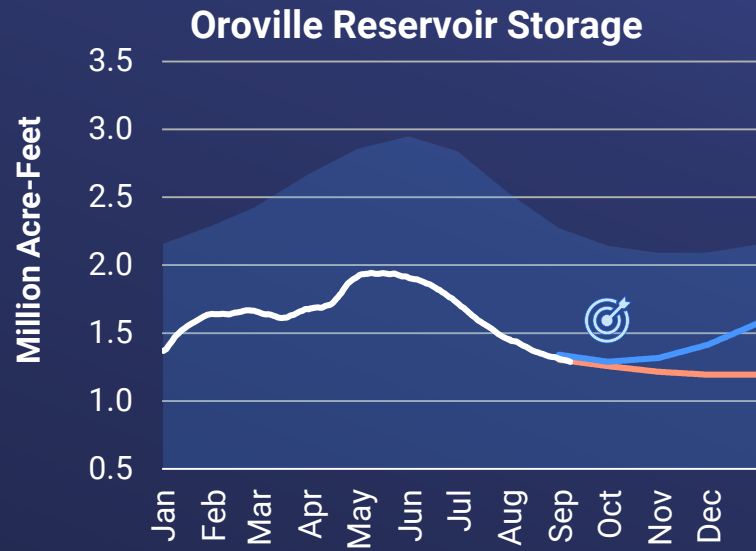

■ Average — 99% Forecast
— 50% Forecast — 2022

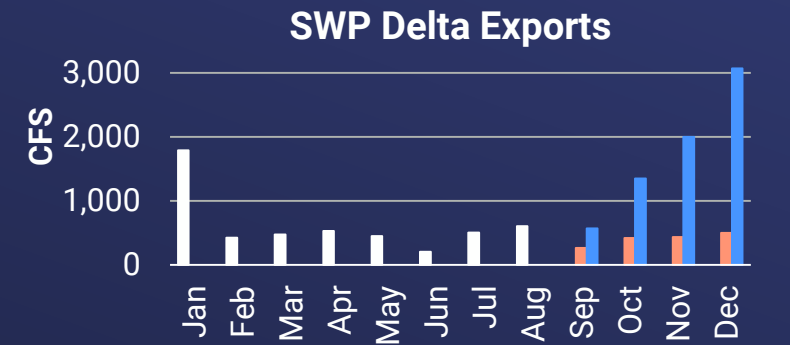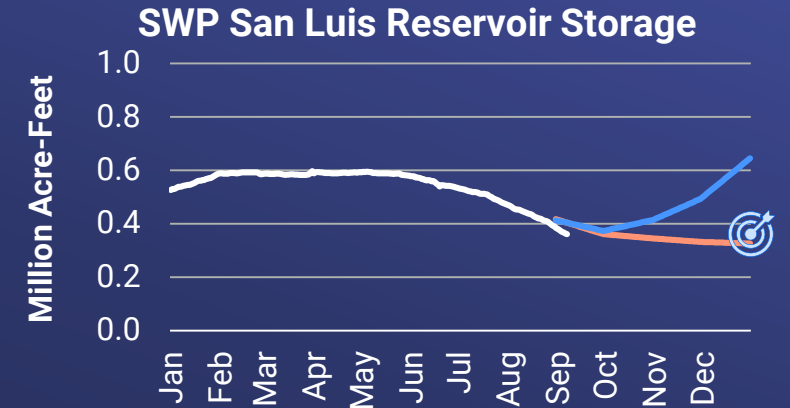

SWP Energy Emergency Response

DWR Actions to Support Grid

- Hyatt shifted 450-650 MW generation to peak hours
- Edmonston not pumping super peak hours
- Valley string pumping minimized peak times
- DWR pre-positioned water for generation
- DWR activated temporary emergency generators at Yuba City and Roseville



